


*NOTE:
CONTRACTOR TO VERIFY LOCATION
AND ELEVATION PRIOR TO START
OF CONSTRUCTION.

PROFILE SCALES
HORIZ.: 1"=40'
VERT.: 1"=4'

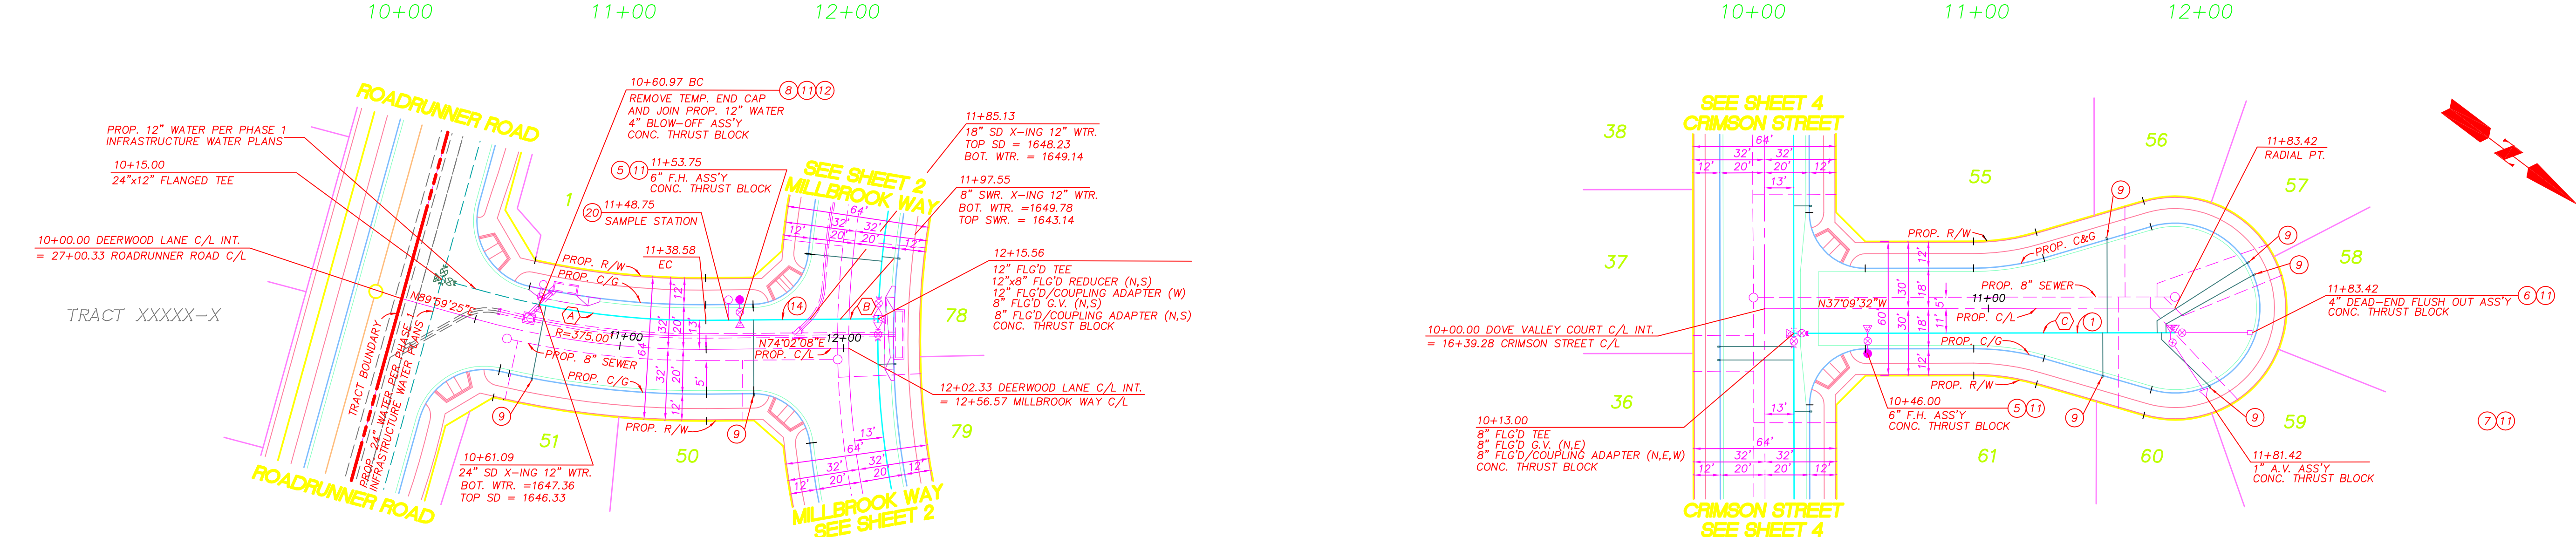

DEERWOOD LANE


DOVE VALLEY COURT

CONSTRUCTION NOTES

- ① CONSTRUCT 8" AWWA C900 PVC CLASS 200 OR CLASS 150, 10 GA CEMENT MORTAR LINED AND COATED STEEL PIPE IN TRENCH PER WWD STD DETAIL W-1
- ② FURNISH AND INSTALL 1" WATER LATERAL AND METER SERVICE PER WWD STD DETAIL W-4
- ③ FURNISH AND INSTALL 6" FIRE HYDRANT ASSEMBLY PER WWD STD DETAIL W-2
- ④ FURNISH AND INSTALL CONCRETE THRUST BLOCK PER WWD STD. DETAIL W-3A THRU W-3D
- ⑤ FURNISH AND INSTALL 4" DEAD-END FLUST OU PER WWD STD DETAIL W-8
- ⑥ REMOVE TEMPORARY END CAP AND JOIN PROPOSED 12" WATER
- ⑦ FURNISH AND INSTALL 1" AIR VALVE PER WWD DETAIL W-6A
- ⑧ FURNISH AND INSTALL 12" AWWA C900 PVC CLASS 200 OR CLASS 150, 10 GA CEMENT MORTAR LINED & COATED STEEL PIPE IN TRENCH PER WWD STD. DETAIL W-1
- ⑨ FURNISH AND INSTALL 4" BLOW-OFF ASSEMBLY PER WWD DETAIL W-7
- ⑩ FURNISH AND INSTALL WATER QUALITY SAMPLE STATION PER WWD STD DETAIL W-21

CURVE/LINE DATA

	DELTA/BEARING	RADIUS	LEN/DIST.	TANGENT
(A)	11°51'27"	362.00'	74.92'	37.59'
(B)	N74°02'08"E	-	76.99'	-
(C)	N37°09'32"W	-	170.42'	-

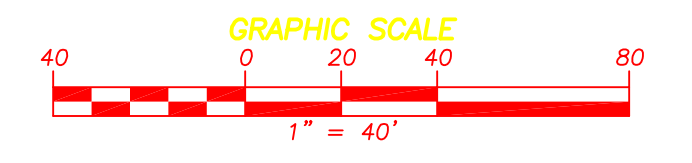

NOTE: ALL STATIONS BASED ON STREET CENTERLINE

<p>CONSTRUCTION CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, CONSTRUCTION CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY, THAT THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS, AND CONSTRUCTION CONTRACTOR FURTHER AGREES TO DEFEND, INDEMNIFY AND HOLD DESIGN PROFESSIONAL HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF DESIGN PROFESSIONAL.</p>		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th>Revision</th> <th>No.</th> <th>By</th> <th>Date</th> <th>Approval</th> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table>	Revision	No.	By	Date	Approval						<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>APPROVED</td> <td>_____</td> <td>Date</td> <td>_____</td> </tr> <tr> <td>Designed</td> <td>_____</td> <td>Checked</td> <td>_____</td> </tr> <tr> <td>Drawn</td> <td>_____</td> <td>Job No.</td> <td>_____</td> </tr> </table>	APPROVED	_____	Date	_____	Designed	_____	Checked	_____	Drawn	_____	Job No.	_____		<p>COMPANY NAME, LOGO AND ADDRESS</p> <p>PREPARED UNDER THE SUPERVISION OF:</p> <p>_____, P.E. R.C.E. _____ DATE _____</p>	<p>NAME WATER DISTRICT</p> <p>WATERLINE IMPROVEMENTS PLANS - TRACT</p> <p>DEERWOOD LANE - STA. 10+60.97 TO STA. 12+15.56</p> <p>DOVE VALLEY COURT - STA. 10+13.00 TO STA. 11+83.42</p>	<p>SHEET 6 OF SHEETS 6 DWG. NO.</p>
Revision	No.	By	Date	Approval																									
APPROVED	_____	Date	_____																										
Designed	_____	Checked	_____																										
Drawn	_____	Job No.	_____																										